

**RHODE ISLAND  
STATE BUILDING CODE**

**SBC-8 State Energy Conservation Code**

Effective August 1, 2007

Replaces Regulation SBC-8

Dated September 1, 2004



STATE OF RHODE ISLAND AND PROVIDENCE PLANTATIONS

**Department of Administration  
BUILDING CODE STANDARDS COMMITTEE  
One Capitol Hill  
Providence, Rhode Island 02908-5859  
(401) 222-3033  
FAX No. (401) 222-2599**

**9<sup>th</sup> EDITION**

**THIS PAGE LEFT INTENTIONALLY BLANK**

**Regulation SBC-8  
State Energy Conservation Code  
August 1, 2007**

**The Building Code Standards Committee, in accordance with the rule making authority of Title 23, Chapter 23-27.3, Section 109.1, paragraphs a through c inclusive, has formally adopted and promulgated as the Rhode Island State Building Code, the provisions of the International Energy Conservation Code, 2006 edition, as published by the International Code Council, Inc. (I.C.C.), together with amendments thereto hereinafter set forth to the articles and sections of this code:**

**The provisions of Title 23, Chapter 27.3 of the General Laws of Rhode Island establishing administration and enforcement are hereby incorporated by reference. Regulatory Administration Chapter 1 immediately follows and is supplemental to the General Laws.**

*Editorial Note: Code users please note:*

*When purchasing or using the State Energy Conservation Code 2006 code, please take note of the particular printing edition. Errata to that printing edition is available on-line directly at no charge at [www.iccsafe.org/cs/codes/errata.html](http://www.iccsafe.org/cs/codes/errata.html) or call the office of the State Building Code Commissioner at 401-222-3033 for further information.*

*Printed copies of the administrative and enforcement provisions of Title 23, Chapter 27.3 are available at the Office of the State Building Code Commission or on-line at [www.rilim.state.ri.us/statutes/title23/23 27.3/index.htm](http://www.rilim.state.ri.us/statutes/title23/23%2027.3/index.htm).*

*The State Energy Conservation Code, 2006 Edition, is protected by the copyright that has been issued to the ICC. As a result, the State Building Code is not available in complete form to the public in an electronic format. The State Energy Conservation Code 2006 edition that is referred to within is contained in a printed volume and is also in an electronic format that have been published by the ICC under an exclusive license.*

*The Office of the State Building Code Commissioner has purchased volumes of these codes and they shall be distributed to Rhode Island cities and towns during the month of June 2007 so that local officials will have access to the code prior to the implementation of these rules on July 1, 2007.*

*In order to assure public access to this code the Office of the State Building Code Commissioner shall provide a copy of this code to the Rhode Island State Library, which is located on the second floor of the State House. In addition, all codes may be viewed during business hours at the Department of Administration's Library which is located on the fourth floor of the William E. Powers Building, One Capitol Hill, Providence.*

*The Legislative Regulation Committee approved adoption of this code on July 10, 2007.*

*By:*

*John P. Leyden*

*Executive Secretary*

*Rhode Island Building Code Standards Committee*

**THIS PAGE LEFT INTENTIONALLY BLANK**

**STATE OF RHODE ISLAND  
BUILDING CODE STANDARDS COMMITTEE**

**CHAIRMAN**

Dana Newbrook, RA  
Architect

**VICE CHAIRMAN**

Stephen C. Turner, PE  
Public Member

**EXECUTIVE  
COMMITTEE**

Allan Durand  
Builders Trades Council

Robert M. Stillings  
Architect

Bruce Davey, PE  
Structural Engineer

Russell Brown  
Building Official

John Pagliaro  
Building Official

James R. Carlson, RA  
Public Member

David F. Palmisciano  
Building Trades Council

G. Thomas Chabot  
Electrical Contractor

Gordon W. Preiss, PE  
Mechanical Engineer

Randy Collins, Jr., RLA  
Landscape Architect

William J. Nash, Jr.  
Building Official

Robert E. DeBlois, Jr.  
Builder

Vacant  
Builder

Paul DePace, PE  
Representative for the Disabled

Vacant  
Electrical Inspector

Donald Gagnon  
Minimum Housing Inspector

Vacant  
Public Health Official

John D. Gaskell, PE  
Electrical Engineer

Vacant  
Representative for the Disabled

Leonard P. Gemma  
Master Plumber

John P. Leyden, CBO  
State Building Commissioner  
Executive Secretary

William Howe  
Fire Official

Vacant  
Legal Counsel

**THIS PAGE LEFT INTENTIONALLY BLANK**

## STATE BUILDING CODE REGULATIONS – 2007

The following list includes all regulations promulgated by the State Building Code Standards Committee. All regulations are available for a fee at the State Building Commission.

|            |                                                                                                                           |                    |
|------------|---------------------------------------------------------------------------------------------------------------------------|--------------------|
| <u>1.</u>  | <u>Building Code</u>                                                                                                      | <u>SBC-1-2007</u>  |
| <u>2..</u> | <u>One and Two Family Dwelling Code</u>                                                                                   | <u>SBC-2-2007</u>  |
| <u>3.</u>  | <u>Plumbing Code</u>                                                                                                      | <u>SBC-3-2007</u>  |
| <u>4.</u>  | <u>Mechanical Code</u>                                                                                                    | <u>SBC-4-2007</u>  |
| <u>5.</u>  | <u>Electrical Code</u>                                                                                                    | <u>SBC-5-2006</u>  |
| <u>6.</u>  | <u>Reserved</u>                                                                                                           |                    |
| <u>7.</u>  | <u>Reserved</u>                                                                                                           |                    |
| <u>8.</u>  | <u>Energy Conservation Code</u>                                                                                           | <u>SBC-8-2007</u>  |
| <u>9</u>   | <u>Enforcement and Implementation Procedures for<br/>Projects Under the Jurisdiction of<br/>The State of Rhode Island</u> | <u>SBC-9</u>       |
| <u>10.</u> | <u>Code Interpretations</u>                                                                                               | <u>SBC-10</u>      |
| <u>11.</u> | <u>Certification of Building Officials,<br/>Building, Electrical, Plumbing and Mechanical<br/>Inspectors</u>              | <u>SBC-11-2002</u> |
| <u>12.</u> | <u>New Materials and Methods of Construction</u>                                                                          | <u>SBC-12</u>      |
| <u>13.</u> | <u>State Building Code for Existing Schools</u>                                                                           | <u>SBC-13</u>      |
| <u>14.</u> | <u>Reserved</u>                                                                                                           |                    |
| <u>15.</u> | <u>Reserved</u>                                                                                                           |                    |
| <u>16.</u> | <u>Reserved</u>                                                                                                           |                    |
| <u>17.</u> | <u>Public Buildings Accessibility Meeting Standards</u>                                                                   | <u>SBC-17</u>      |
| <u>18.</u> | <u>Native Lumber</u>                                                                                                      | <u>SBC-18</u>      |
| <u>19.</u> | <u>Fuel Gas Code</u>                                                                                                      | <u>SBC-19-2007</u> |

**THIS PAGE LEFT INTENTIONALLY BLANK**

Format: These code changes follow numbering sequence and topics of the INTERNATIONAL ENERGY CONSERVATION CODE 2006 (first printing). All Provisions of IECC 2006 are retained unless indicated as deleted or revised. Published errata is available from the ICC website dependent on the printing issue number and date.

## Chapter 1

### ADMINISTRATION

Revise IECC section 101.1, Title, to read as follows:

**101.1 Title:** These regulations shall be known as the State Energy Conservation Code Regulation SBC-8 - 2007 hereafter referred to as " this code".

Add the following new section 101.1.1 referenced codes.

**101.1.1 Referenced Codes.** The other codes listed in Sections 101.4.1 through 101.4.7 and referenced elsewhere in this code shall be considered part of the requirements of this code to the prescribed extent of each such reference.

1. **Electrical.** The provisions of Rhode Island State Electrical Code SBC-5-2006 shall apply wherever referenced in this code as the ICC Electrical Code, and shall apply to the installation of electrical systems, including alterations, repairs, replacement, equipment, appliances, fixtures, fittings, and appurtenances thereto.
2. **Gas.** The provisions of the Rhode Island State Fuel Gas Code SBC-19-2007 shall apply wherever referenced in this code as the International Fuel Gas Code, and shall apply to the installation of gas piping from the point of delivery, gas appliances and related accessories as covered in this code. These requirements apply to gas piping systems extending from the point of delivery to the inlet connections of appliances and the installation and operation of residential and commercial gas appliances and related accessories.
3. **Mechanical.** The provisions of the Rhode Island State Mechanical Code SBC-4-2007 shall apply wherever referenced in this code as the International Mechanical Code and shall apply to the installation, alterations, repairs and replacement of the mechanical systems, including equipment, appliances, fixtures, fittings and/or appurtenances, including ventilating, heating, cooling, air-conditioning and refrigeration systems, incinerators and other energy-related systems.

4. **Plumbing.** The provisions of Rhode Island State Plumbing Code SBC-3-2007 shall apply wherever referenced in this code as the International Plumbing Code, and shall apply to the installation, alteration, repair and replacement of plumbing systems, including equipment, appliances, fixtures, fittings and appurtenances, and where connected to a water or sewage system and all aspects of a medical gas system.
5. **Property Maintenance.** Refer to state or local codes.
6. **Fire Prevention Code.** Wherever and whenever provisions of the International Fire Code 2003 editions are referenced, the appropriate Rhode Island Fire Safety Code requirements shall apply.
7. **Building Code.** The provisions of the Rhode Island State Building Code SBC-1-2007 shall apply wherever referenced in this code as the International Building Code, and shall apply to all matters governing the design and construction of buildings.
8. **Existing Building Code.** The provisions of the State Building Codes SBC-1-2007 in conjunction with the State Rehabilitation Code SRC-1 and the Rhode Island Fire Safety Code shall apply wherever referenced in this code as the International Existing Building Code.

Any and all such references to the various International Code Council family of code shall be substituted for the appropriate state code as indicated above.

## Chapter 3

### Climate Zones

Delete section 301 in its entirety and substitute the following.

#### Section 301 Climate Zones

**301.1 General** Rhode Island shall be considered as climate zone 5A with the following design conditions.

| Add the following Table                           |                   |            |
|---------------------------------------------------|-------------------|------------|
| <b>Table 301.1</b><br>Exterior Design Conditions. | Value             | Value      |
| Climate zone                                      | Providence County | All others |
| Winter, design dry-bulb (degree F)                | 0                 | 5          |
| Summer, design dry-bulb                           | 87                | 89         |
| Summer design wet-bulb                            | 71                | 73         |
| Degree days heating                               | 6831              | 5950       |
| Degree days cooling                               | 371               | 811        |

Add the Following Figure 301.1

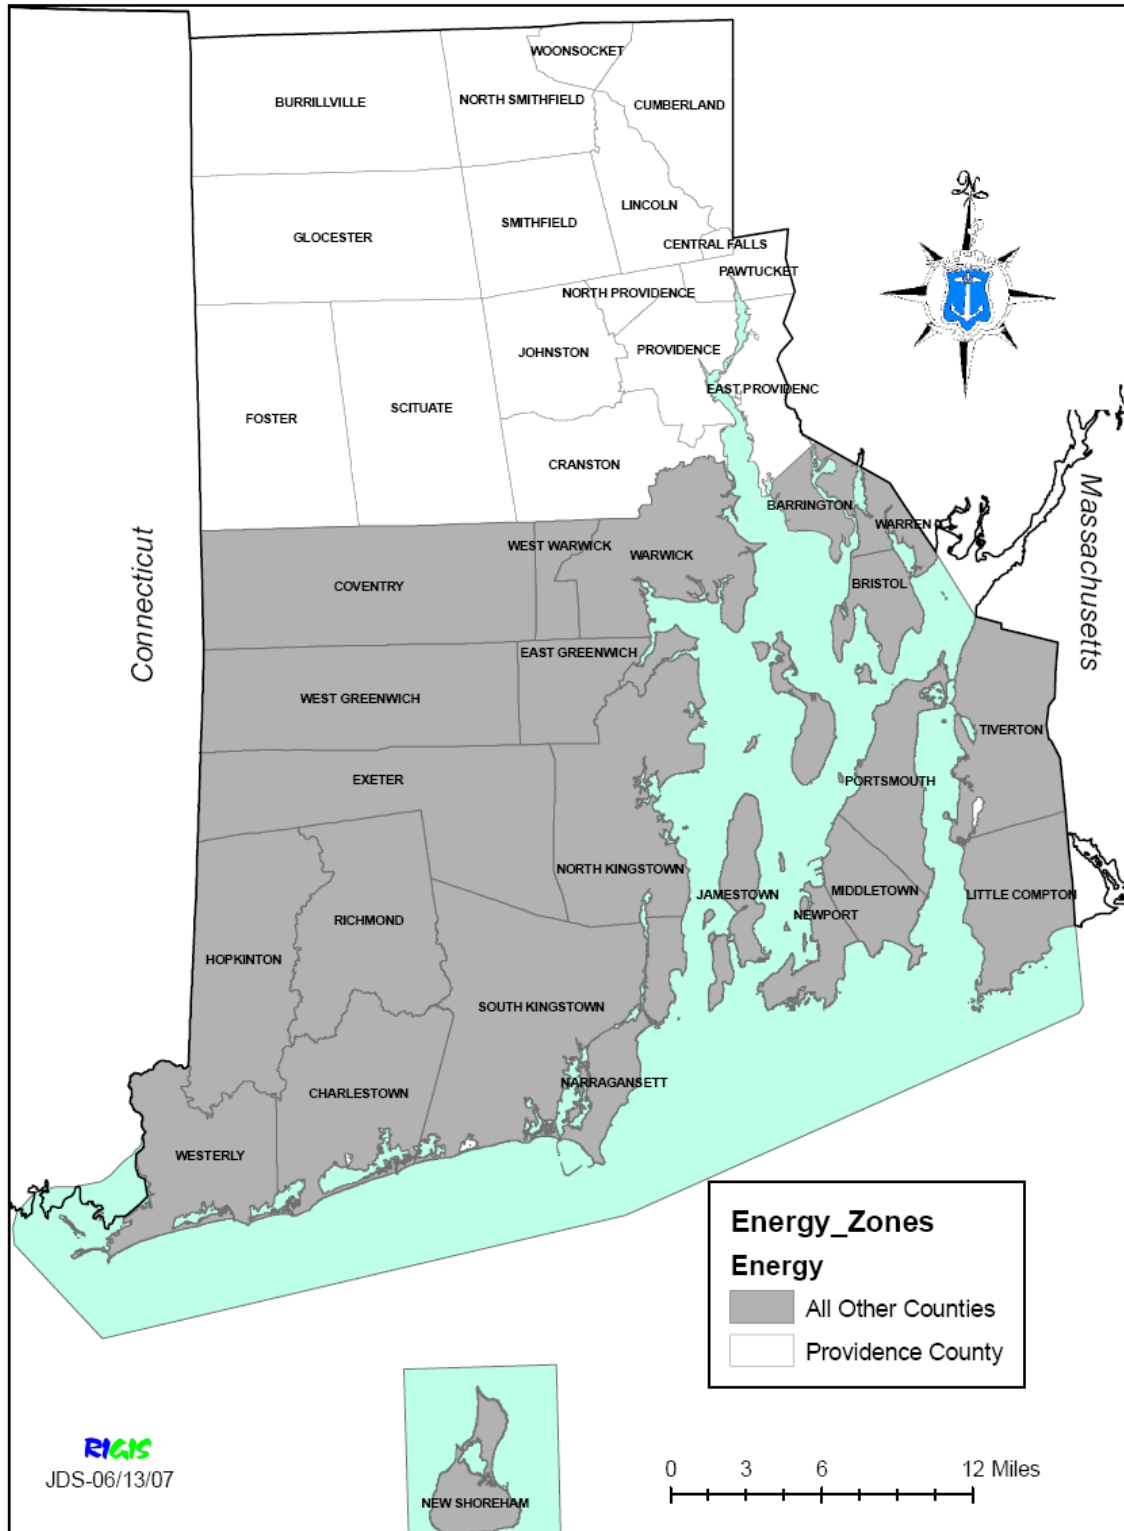


Figure 301

## Chapter 4

401.2 Delete and substitute the following:

401.2 Compliance shall be demonstrated by either;

1. Meeting the requirements of this chapter using the criteria for climate zone 5 from figure 301.1 or.
2. Meeting the following prescriptive requirements listed as table 402.1.1 or
3. Compliance submission of Res-Check for Zone5 and Chapter4

**401.3 Certificate:** Add the following

A certificate similar to this shall be attached to or near the electrical panel board.

| ENERGY CERTIFICATE                                              |       |
|-----------------------------------------------------------------|-------|
| STREET ADDRESS:                                                 | _____ |
| CITY/TOWN:                                                      | _____ |
| PREDOMINANT VALUES:                                             |       |
| R VALUE CEILING/ROOF                                            | _____ |
| R VALUE WALLS                                                   | _____ |
| R VALUE FOUNDATION                                              | _____ |
| R VALUE DUCTS                                                   | _____ |
| U FACTOR FENESTRATION                                           | _____ |
| U FACTOR SKYLIGHT                                               | _____ |
| AFUE VALUE BOILER/FURNACE                                       | _____ |
| CERTIFICATE COMPLETED BY BUILDER/REGISTERED DESIGN PROFESSIONAL |       |
| _____<br>SIGNATURE                                              |       |

Delete Table 402.1.1 and substitute the following

**TABLE 402.1.1**  
**INSULATION AND FENESTRATION REQUIREMENTS BY COMPONENT**

| <b>Window Area Percentage of Exterior Wall Area</b> | <b>Fenestration U-Factor</b> | <b>Skylight U-Factor</b> | <b>Ceiling R-Value</b> | <b>Frame Wall R-Value</b>   | <b>Mass Wall R-Value</b> | <b>Floor R-Value</b> | <b>Basement Wall R-Value</b> | <b>Crawl Space R-Value</b> |
|-----------------------------------------------------|------------------------------|--------------------------|------------------------|-----------------------------|--------------------------|----------------------|------------------------------|----------------------------|
| 0> 17.5                                             | 0..35                        | 0.60                     | R-38                   | R-15 or R13 +5 <sup>a</sup> | R-13                     | R-19/30 <sup>b</sup> | R-10                         | R10/13 <sup>c</sup>        |
| 17.51>25                                            | 0.35                         | 0.60                     | R-38                   | R-19 or R13 +5 <sup>a</sup> | R-13                     | R-30                 | R-13                         | R10/13 <sup>c</sup>        |

Footnote:

- a. "13 +5" means R-13 cavity insulation plus R-5 insulated sheathing.
- b. R-19 / 30 means R-19 at floors above occupiable (unheated basements) areas; and R-30 above open crawl space and garage areas.
- c. R 10 / 13 means R-10 continuous or R-13 at cavity

- Notes:
1. If window area exceeds 25% of gross exterior conditioned space wall area, the provisions of Chapter 4 prevail.
  2. R-Value 10.0 insulation shall be installed for unheated slab on grade structures from grade to 2' (two feet) below grade and shall be protected against physical damage in accordance with Section R403.3.2. of Residential Code SBC-2
  3. Sliding glass doors and fully glazed patio doors shall be considered windows for the purpose of this table
  4. Roof/ceiling assemblies in which the finished interior surface is the underside of the roof sheathing, or where the finished ceiling surface is attached to the underside of the roof framing member (i.e. cathedral ceilings), shall have a minimum R-value of 30. Additionally insulation provided the exterior walls of the structure or portion containing such conditions shall have an accompanying wall insulation value of R-19 or better, and a glass U-factor with a maximum of 0.35.
  5. Mass walls shall meet the R-value requirements of Section 402.2.3
  6. Skylights and roof windows shall have a maximum U factor of 0.60.

**401.3** Add the following 401.3.1 Certificate:

A certificate similar to this shall be attached to or near the electrical panel board.

**402.1.4** Delete and substitute the following:

**402.1.4 Total UA Alternative.**

If the total building thermal envelope UA (sum of U-factor times the assembly area) is less than or equal to the total UA resulting from using the U-factors in table 402.1.3 (multiplied by the same assembly area as in the proposed building) the building shall be considered in compliance with the Table 402.1.1. The UA calculations shall be done using an approved methodology.

Add the following section:

**403.7 Minimum equipment performance.** Heating and cooling equipment shall have minimum

equipment performance as indicated in Table 403.1.

**TABLE 403.1**  
**MINIMUM EQUIPMENT PERFORMANCE**

| <b>EQUIPMENT CATEGORY</b>                                                               | <b>SUBCATEGORY</b> | <b>REFERENCED STANDARD</b>                 | <b>MINIMUM PERFORMANCE</b> |
|-----------------------------------------------------------------------------------------|--------------------|--------------------------------------------|----------------------------|
| Air-cooled heat pumps, Heating mode<65,000 Btu/h cooling capacity                       | Split systems      | ARI 210/240                                | 8 HSPF <sup>a,b</sup>      |
|                                                                                         | Single package     |                                            | 7.6 HSPF <sup>a,b</sup>    |
| Gas-fired or oil-fired furnace <225,000 Btu/h                                           | —                  | DOE 10 CFR Part 430, Subpart B, Appendix N | AFUE 85% <sup>b</sup>      |
| Gas-fired or oil fired steam and hot-water boilers <300,000 Btu/h                       | —                  | DOE 10 CFR Part 430, Subpart B, Appendix N | AFUE 80% <sup>b, c</sup>   |
| Air-cooled air conditioners and heat pumps, Cooling mode <65,000 Btu/h cooling capacity | Split systems      | ARI 210/240                                | 13.0 SEER <sup>b</sup>     |
|                                                                                         | Single package     |                                            | 12.0 SEER <sup>b</sup>     |

For SI: 1 British thermal unit per hour = 0.2931 W.

- a. For multi-capacity equipment, the minimum performance shall apply to each capacity step provided. Multi-capacity refers to manufacturer-published ratings for more than one capacity mode allowed by the product's controls.
- b. This is used to be consistent with the National Appliance Energy Conservation Act (NAECA) of 1987 (Public Law 100-12).
- c. Except for gas-fired steam boilers for which the minimum AFUE shall be 75 percent.
- d. Seasonal rating.

Delete **footnotes e and f of Table 404.5.2(1)** and substitute the following

- e. Tested envelope leakage shall be determined and documented by an independent party approved by the code official.
- f. The combined air exchange rate for infiltration and mechanical ventilation shall be determined and documented by an independent party approved by the code official.

Add the following sections.

**405 Pools.** All pools shall be provided with energy conserving measures in accordance with sections 405.1 through 405.3

**Pool heaters.** All pool heaters shall be equipped with a readily accessible on-off switch to allow shutting off the heater without adjusting the thermostat setting, Pool heaters fire by natural gas shall not have continuously burning pilot lights.

**Time Switches.** Time switches that can automatically turn off and on heaters and pumps according to a preset schedule shall be installed on swimming pool heaters and pumps.

**Exception:**

1. Where pumps are required to operate solar-and waste-heat- recovery pool heating systems.

**Pool covers.** Heated pools shall be equipped with a vapor retardant pool covers on or at water surface. Pools heated more than 90F (32C) shall have a pool cover with a minimum insulation value of R-12.

**Exception:**

Pools deriving over 60 percent of the energy for heating from site-recovered energy or solar energy source.

## Chapter 5

**501.2 Delete and substitute.** Where one or more of these sections is not satisfied. Compliance with all of the applicable provisions of ASHRAE/IESNA 90.1 shall be demonstrated.

**Table 502.2 (1)** Revise as shown.

|                  |                                                                       |
|------------------|-----------------------------------------------------------------------|
| Below Grade Wall | R-5 Continuous<br>R-7.5 Noncontinuous                                 |
| Unheated Slabs   | R-3 Thermal break at wall to floor joint<br>R-7.5 for 24 inches below |

**502.4.6 Revise the following exception.**

2. Doors not intended to be used as building entrance doors.

Add the following exception:

7. Doors other than main entrance doors in building four stories or less.

### **503.2.1 Delete and substitute**

**503.2.1 Calculation of heating loads.** Documented design load calculations shall be provided by the design professional upon request of the A.H.J. Heating and cooling loads shall be adjusted to account for load reductions that are achieved when energy recovery systems are utilized in the HVAC system. Design loads shall be determined by an approved equivalent computation procedure, using the design parameters specified in chapter 3. Acceptable methods include energy modeling software, spreadsheet calculations, or hand written calculations certified by the design professional.

**503.2.4.2** Add the following exception .

**Exception:** A building equipped with a DDC system may follow manufacturers installation instructions.

**503.2.4.4 Delete and substitute the following exceptions.**

1. Gravity exhaust dampers shall be permitted in buildings less than three stories in height.
2. Gravity dampers shall be permitted for exhaust airflows of 300 CFM (.14 m<sup>3</sup>/s) when serving a single space.

**503.2.7** Duct and plenum insulation and sealing.

**Delete /and substitute.**

..... a minimum of R-8 insulation when located in unconditioned spaces and with a minimum of R-12 when located outside of the building. Exterior installations shall be protected from the weather.....

**503.2.9 Delete and substitute the following**

**503.2.9 HVAC System completion.**

Prior to the issuance of a certificate of occupancy upon the request of the AHJ evidence of system completion in accordance with sections 503.2.9.1 through 503.2.9.3 shall be provided.

**Delete Table 503.3.1(1) and substitute the following table:**

**Table 503.3.1(1)**

|                  |                                                                                                                |
|------------------|----------------------------------------------------------------------------------------------------------------|
| Climate Zone 5-A | Economizers on all individual cooling units<br>$\geq 54,000$ Btu/h                                             |
| Climate Zone 5-A | On 75% of all Cooling systems when the Total<br>Building Load is $\geq 12$ million Btu/h<br>Except Use Group R |